

Technical Data

EATON ROLP SV

CE 11
2831
DoP0059

	ROLP SV	
	AS ISO7240-3:2010 EN54-3	
Operating voltage	18 - 28Vdc 9 - 15Vdc	9 - 28Vdc
Current @24Vdc	20mA	33mA
Cable size	0.28 - 2.5mm ²	0.28 - 2.5mm ²
Ambient temperature (min/max)	-25°C to +70°C	-25°C to +70°C
Material	ABS V0	ABS V0
Environmental category (IP rating)	IP21C (with Shallow Base) IP33C (with Deep or U-base)	IP54* (with Shallow Base) IP66* (with Deep or U-base)
Tones	6	32

* Device not EN54 certified to IP54 or IP66. Manufacturer's declaration.




Fire Alarm Device - Sounder for indoor (type A) and outdoor⁽¹⁾ (type B) use

Essential Characteristics

Harmonized Technical Specification: EN54-3:2001+A1:2002+A2:2006


Clause(s)	Performance
4.2, 4.3, 5.2, 5.3	Pass
4.4, 4.5, 4.6, 5.4	Pass
5.5, 5.6 ⁽¹⁾ , 5.7, 5.8, 5.9	Pass
5.8, 5.9, 5.10 ⁽¹⁾	Pass
5.11	Pass
5.12, 5.13, 5.14, 5.15	Pass
5.16	Pass
5.17	Pass

⁽¹⁾ When installed on a Deep Base or U-Base




6 Way Switch Variants

Example of Tone 3 setting

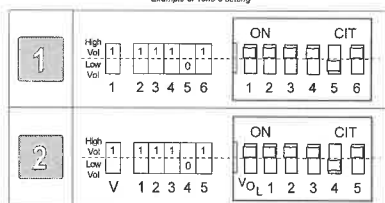

Suitable cable glands to be used for required IP rating

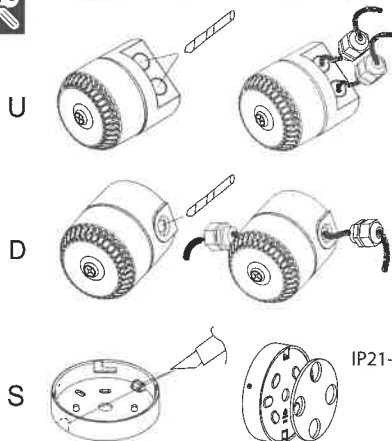

Installation must be in accordance with relevant national wiring regulations or codes for the intended application and voltages employed.

L'installation doit être conforme à la réglementation ou aux codes nationaux de câblage en vigueur, en vue de l'application désirée et des tensions utilisées.

Das Gerät ist für die vorgesehene Anwendung und verwendete Spannung gemäß relevanten Bundesvorschriften und Regeln zur Verkabelung zu installieren.

L'installazione deve essere eseguita in conformità con le disposizioni nazionali vigenti sul cablaggio o i corrispondenti codici per l'applicazione prevista e le tensioni impiegate.

Instalatie moet overeenstemmen met relevante nationale wetgeving of codes voor kabels bij de bedoelde toepassingen en gebruikte voltages.




La instalación debe estar acorde con las principales normas nacionales para cableado o códigos para la aplicación prevista y los voltajes empleados.

Installation måste ske i enlighet med landets gällande lagar eller bestämmelser för dragnings av elektriska kablar till den avsedda enheten och den aktuella spänningen.

Instalacja musi być wykonana zgodnie z obowiązującymi przepisami prawa i wytycznymi zgodnie z przeznaczeniem sygnalizatora i z wartościami zastosowanych napięć.



ROLP SV

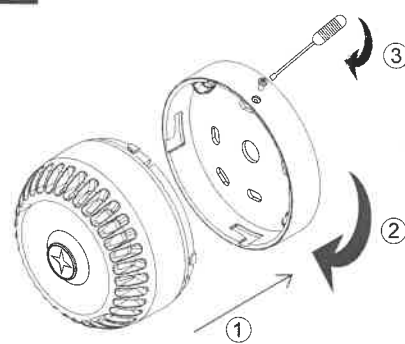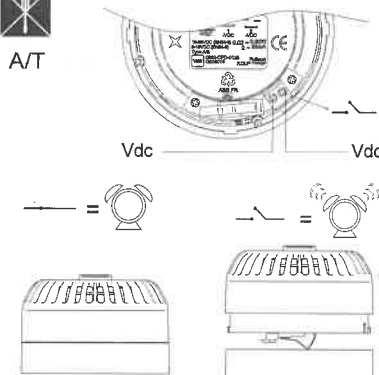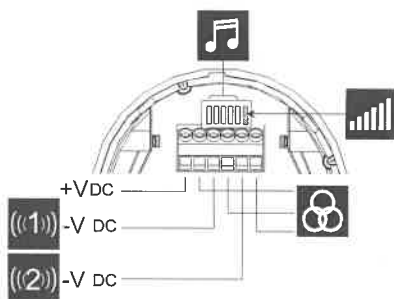

Powering Business Worldwide